
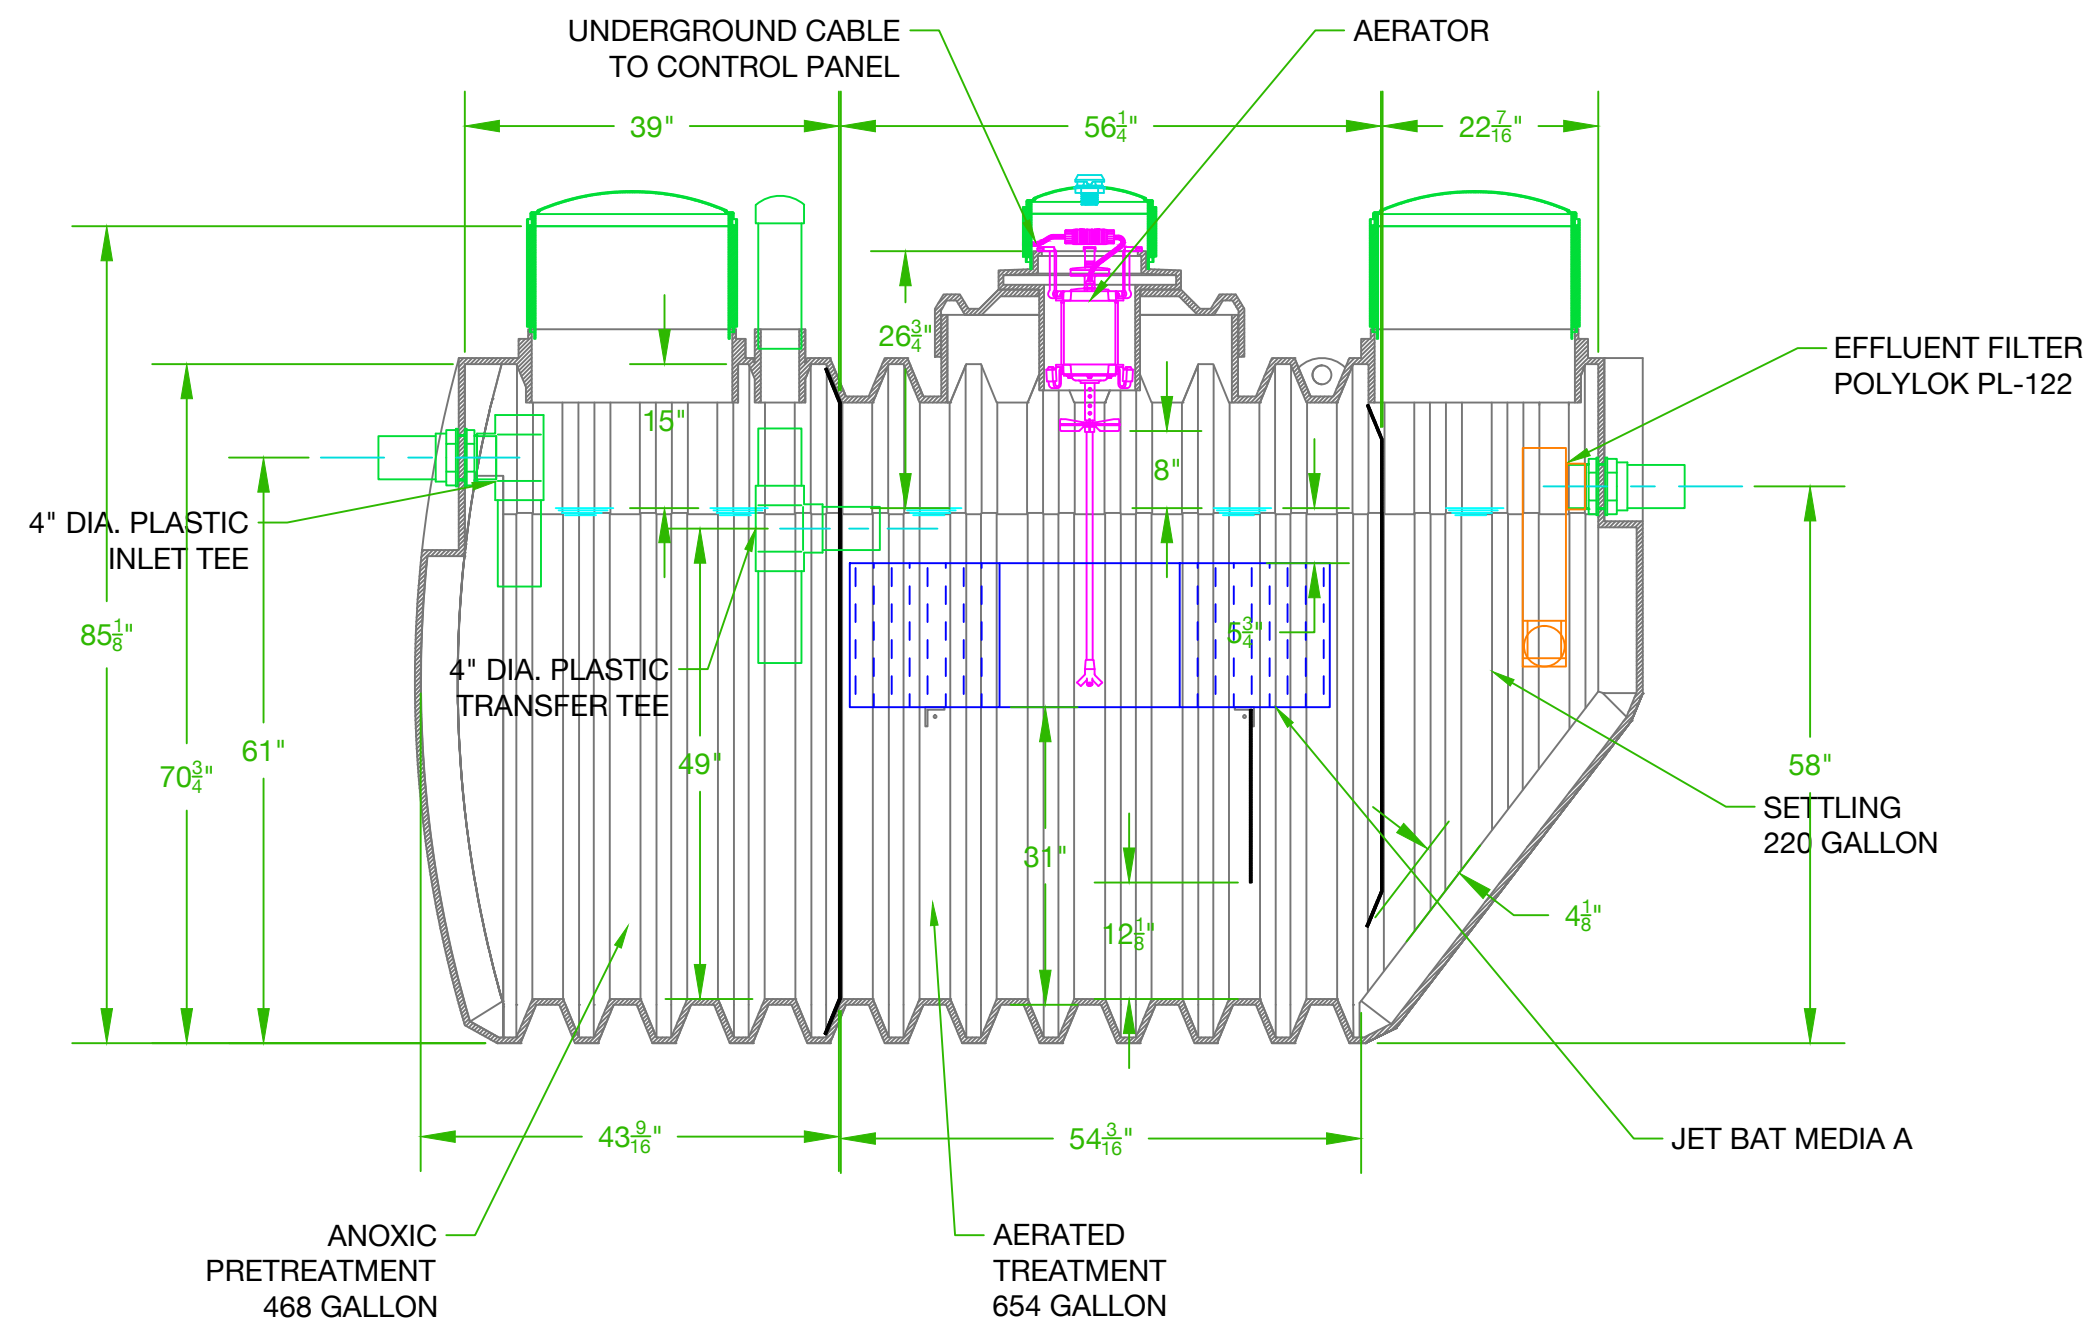



NOTES:

1. AERATOR MODEL 700LL MUST BE USED IN CONTINUOUS OPERATION
2. MAXIMUM BURIAL DEPTH 24" FROM TOP OF TANK
3. J-500 IS CAPABLE OF TREATING UPTO 500 GALLONS OF WASTEWATER WITH AN APPLIED LOADING OF UPTO 0.71 LBS. BOD PER DAY

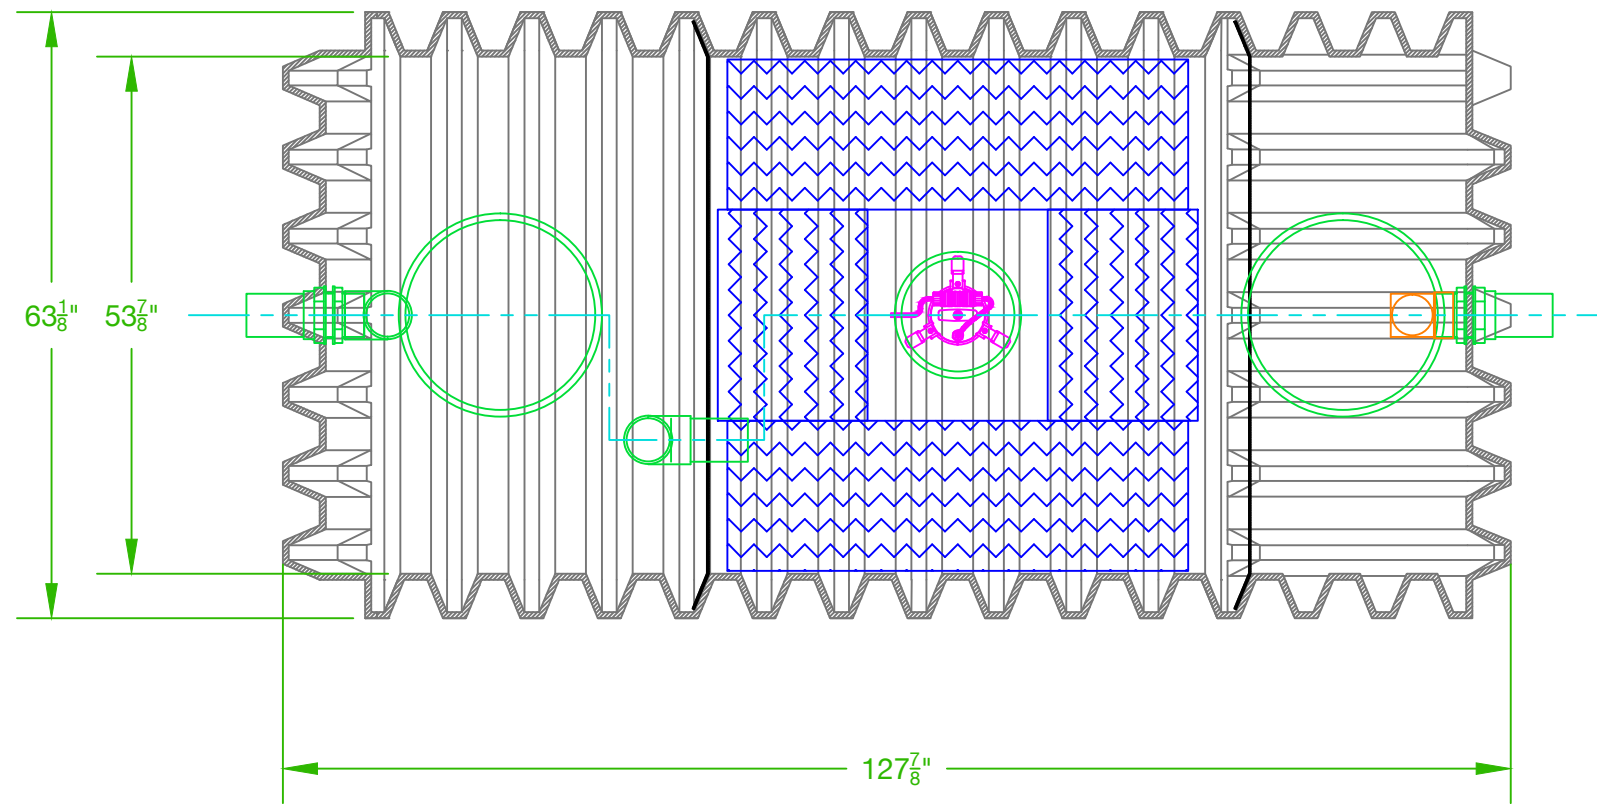

B	1509	9/1/15	CORRECT OUTLET PIPE HEIGHT	N J K	
A	1508	8/18/15	ADD FLOWRATE TO NOTES	N J K	
--	1407	8/14/15	NEW DRAWING	N J K	
REV	ECN	DATE	DESCRIPTION	DRFT	APRV
			 Wastewater Treatment Solutions Founded on Innovation. Anchored by Service.®	DRAWN BY: N J K	DATE 9/1/15
				APPROVED BY:	DATE:
			TITLE: J-500 RESIDENTIAL WWTP PLASTIC TANK WITH EFFLUENT FILTER	SCALE: 1 : 20	SIZE: C
			USED ON:	UNLESS OTHERWISE SPECIFIED: ALL DIMENSIONS ARE IN INCHES DECIMAL: ± .005 FRACTIONAL: ± 1/64 DEGREE: ± 1°	
			PROPRIETARY PROPERTY: THIS DRAWING IS THE PROPERTY OF JET INC. AND MAY NOT BE REPRODUCED, COPIED OR USED WITHOUT WRITTEN PERMISSION.	DRAWING NUMBER: J-500-PLT-F REV: B	